
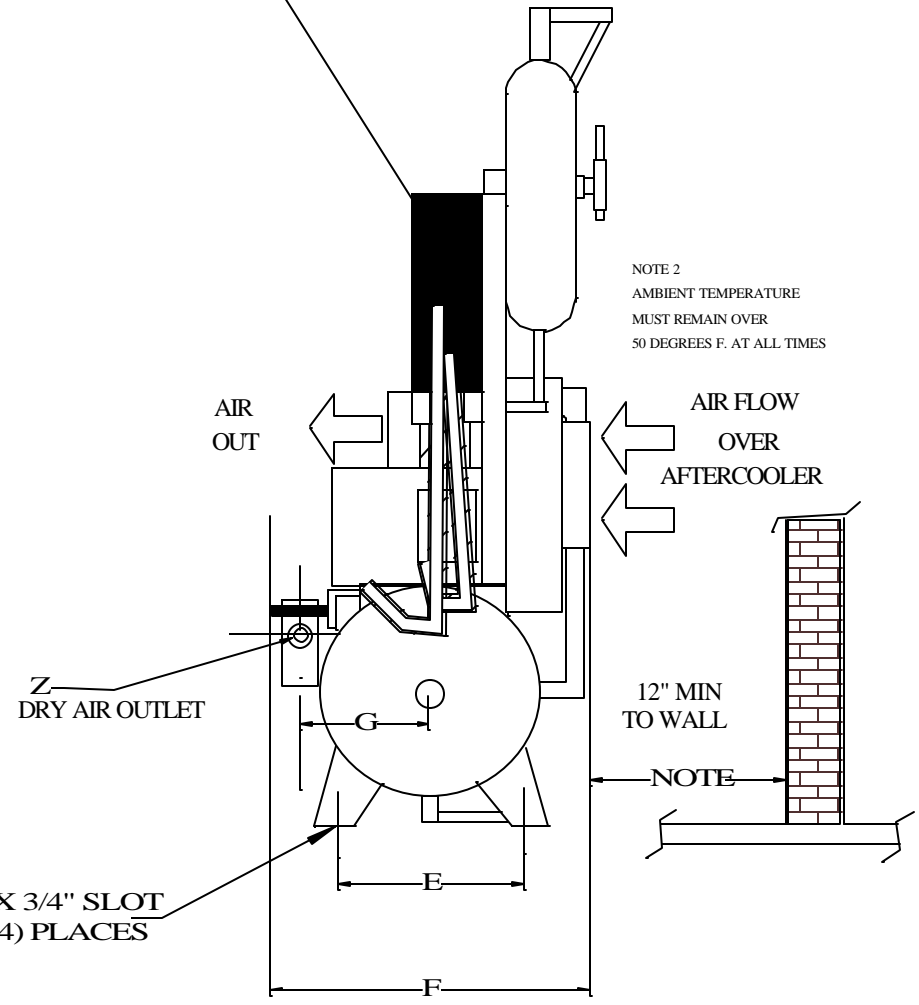


**UL/FM APPROVED
AIR MAINTENANCE DEVICE
STANDARD ON DRY AIR PACS**

CONTROL PANEL CUSTOMER CONNECTION AREA

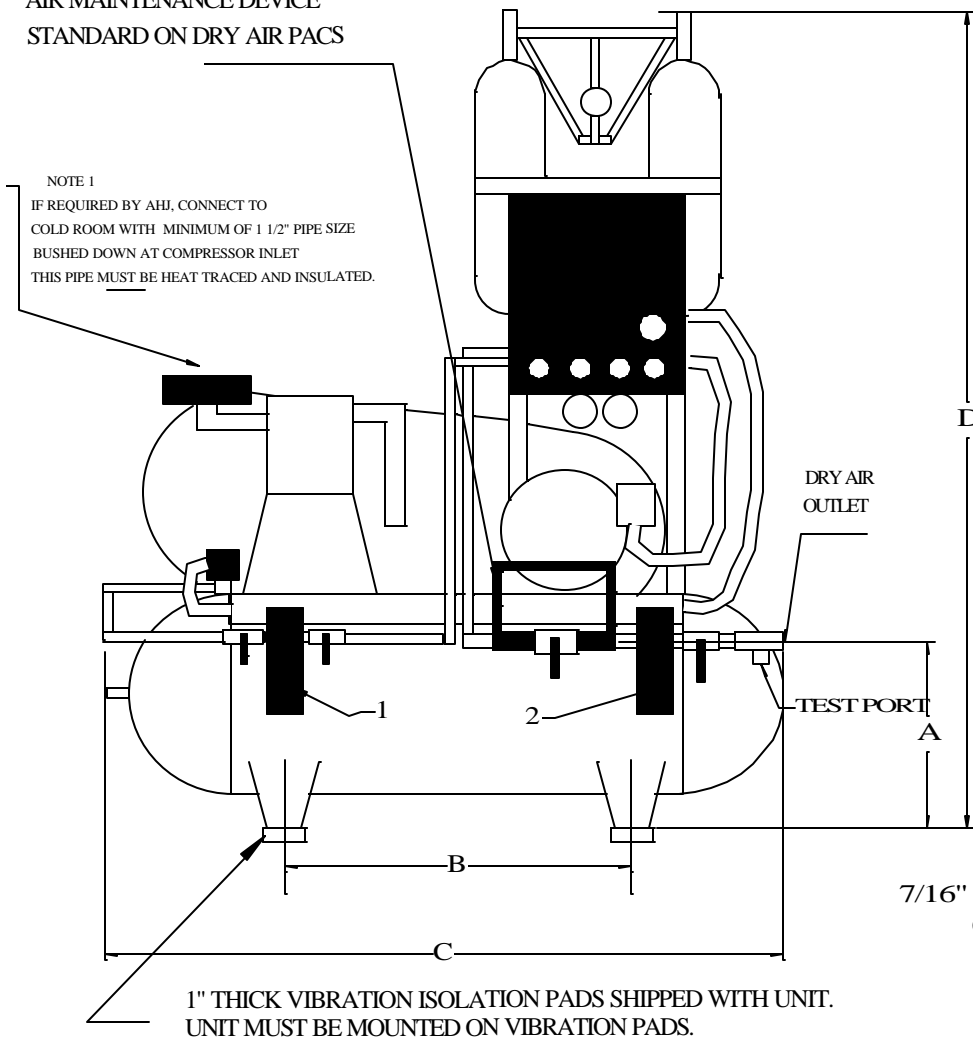

NOTE 2
AMBIENT TEMPERATURE MUST REMAIN OVER 50 DEGREES F. AT ALL TIMES

1. COALESCING FILTER - AHEAD OF DRYER.

2. FILTER REGULATOR, AFTERFILTER - AFTER DRYER.

MODELS DAP 500, 1000 & 2000			DIMENSIONS					
	A	B	C	D	E	F	G	Z
500 1000	17 5/8"	18"	44"	69 1/2"	13"	23 1/2"	10"	1/2" FPT
2000	17 5/8"	18"	44"	72 1/2"	13"	23 1/2"	10"	1/2" FPT

DAPOL

Revisions	General Air Products	
REV 7 ADDED SLOT	Date: 8/15/96	Rev# 7
	Drawn By: RGP	Rev Date: 10/25/05
	Drawing # G-9646	Scale: NTS
Title: DRY AIR PAC OUTLINE DIMENSIONS		