



AIR PRODUCTS

*The Leading Manufacturer of Air Compressors
for the Fire Protection Industry*

OL Series OILLESS TANK MOUNTED COMPRESSORS
for Dry Pipe Sprinkler Systems



- Fully Automatic
- Direct Drive
- Air Intake Filter(s)
- Oil Less Piston Compressor
- UL Listed Pressure Switch
- Bubble Tight Air Check Valve
- Permanently Lubricated Bearings
- A.S.M.E. Coded Tanks
- 1/2" Outlet Connections
- Thermal Overload Protection
- Fills System to 40 PSI in 30 Minutes (NFPA 13)


3 Phase - 60 Cycle Units - 50 Cycle Available, Consult Factory

System Capacity (gallons)**	Model Number	Average CFM*	Motor H.P.	Min. Wire Size ++	Dimensions			Weight (lbs.)	Tank Capacity (gallons)
					L	W	H		
220	OL33550BCT	2.67	1/2	12	32	13.5	23	114	10
320	OL42575BCT	3.88	3/4	12	32	14	24	120	10
425	OL675100BCT	5.15	1	12	32	14	24	124	10
700	OL800150BCT	8.49	1 1/2	12	35	17	32	150	20
950	OL1200V200BCT	11.48	2	12	35	17	32	167	20

* Average CFM is the average free air delivery from 0 to 40 PSIG.

++ Based on 100 foot run. Consult Factory for longer or shorter runs.


** Based on 70 degree F system temp. For other conditions consult factory for pump up times.

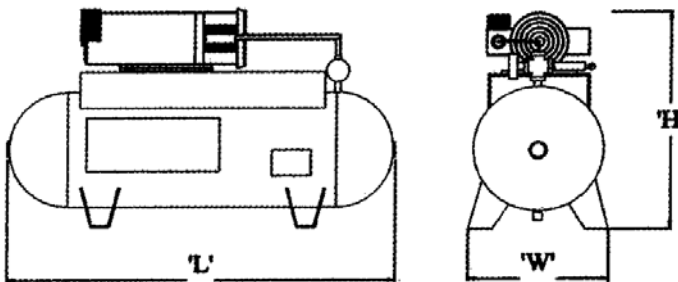

Magnetic Line Starters - Thermal Overload Protection
Three Phase

	208/230V	460V	Size	Model
Maximum HP	1 1/2 HP	2 HP	00	MG00B*
	3 HP	5 HP	0	MGX0B*
	7 1/2 HP	10 HP	1	MG01B*

When Ordering a Magnetic Line Starter you must specify HP, Voltage and Phase that is supplied to the motor.



Air Maintenance Device
Part # AMD-1

The AMD-1 is used when compressed air is supplied through an existing factory air supply or when using tank mounted units.

Call 1-800-345-8207

Fax: 610-524-8965


E-Mail: genairpro@generalairproducts.com

Remember - You can find this sheet and more at
www.GENERALAIRPRODUCTS.com

TANK MOUNTED OIL-LESS COMPRESSORS INSTALLATION INSTRUCTIONS



ALL PIPING AND WIRING TO BE IN ACCORDANCE WITH APPLICABLE STATE, LOCAL AND NATIONAL CODES & SHOULD BE APPROVED BY AHJ

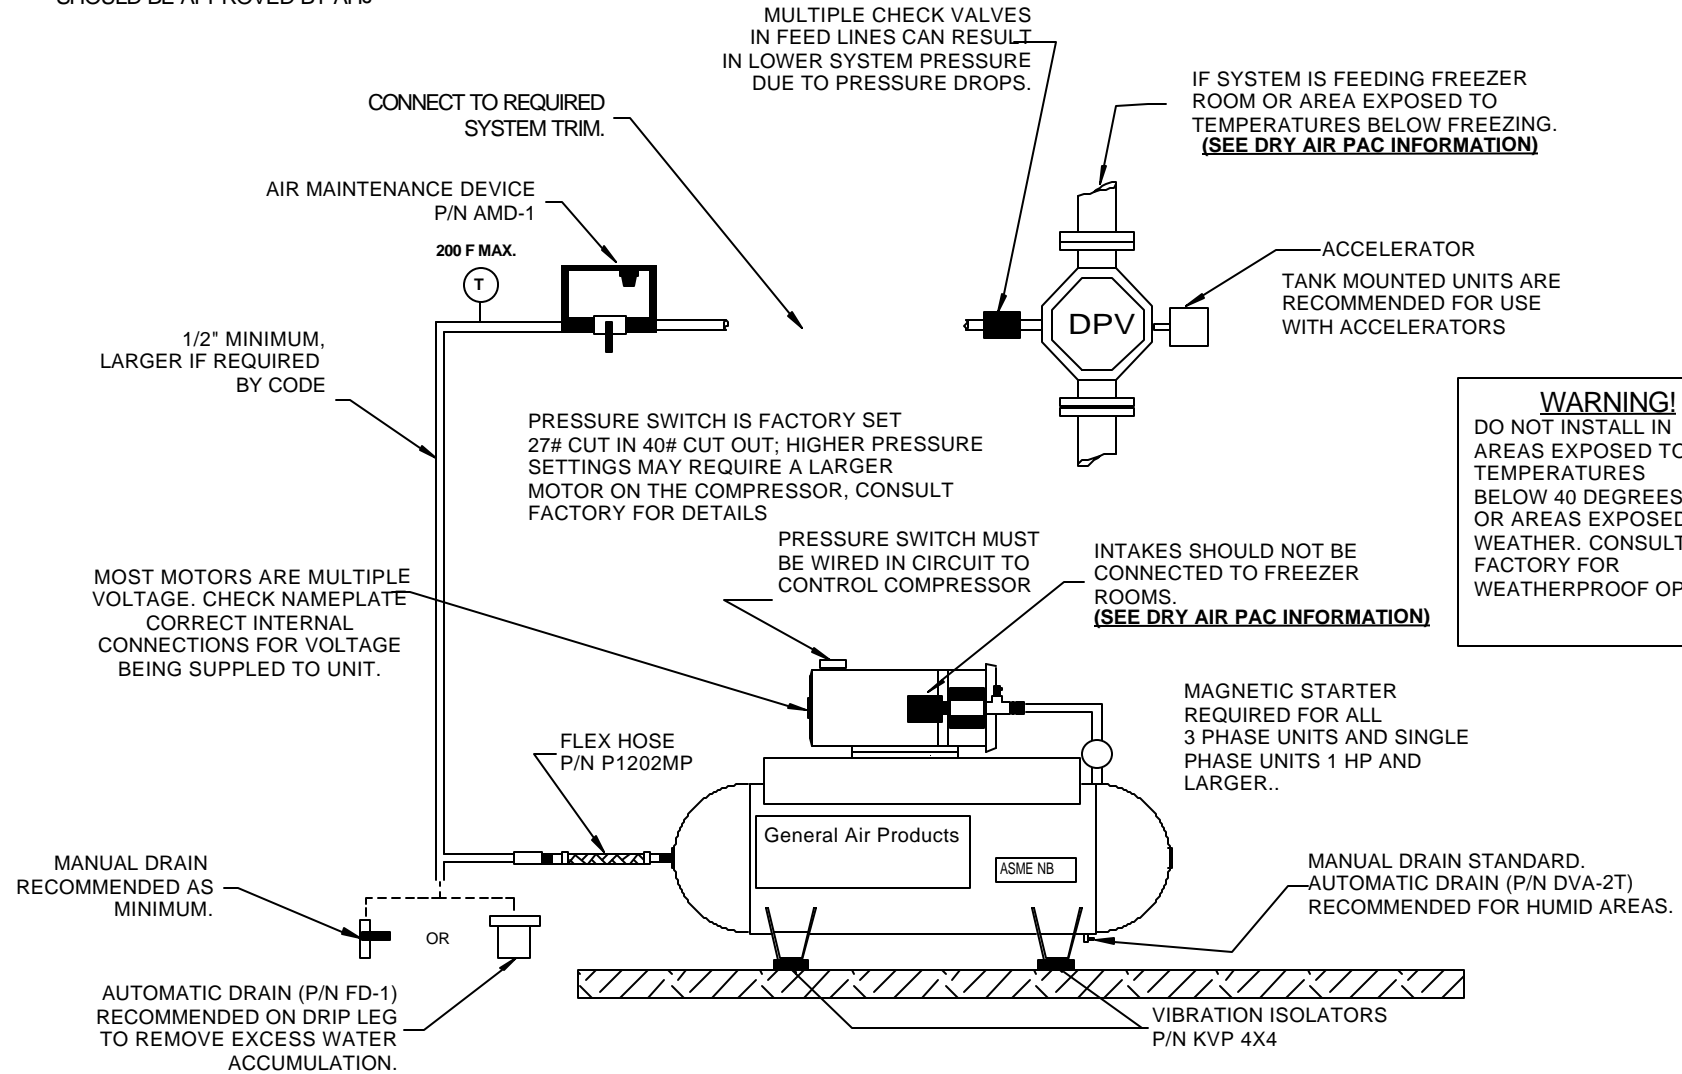

PART NUMBERS LISTED ARE FOR ACCESSORY ITEMS RECOMMENDED FOR COMPLETE INSTALLATION - CONSULT YOUR LOCAL DISTRIBUTOR FOR AVAILABILITY

TNKOLIS (05/03/99)