

**50
Cycle
Units**



*The Leading Manufacturer of Air Compressors
for the Fire Protection Industry*

**50
Cycle
Units**

OILLESS TANK MOUNTED COMPRESSORS

for Dry Pipe Sprinkler Systems



- Fully Automatic
- Direct Drive
- Air Intake Filter(s)
- Oil Less Piston Compressor
- UL Listed Pressure Switch
- Bubble Tight Air Check Valve
- Permanently Lubricated Bearings
- A.S.M.E. Coded Tanks
- 1/2" Outlet Connections
- Thermal Overload Protection
- Fills System to 40 PSI in 30 Minutes (NFPA 13)

50 Cycle Units - 60 Cycle Available, Consult Factory


System Capacity (gal/L)+	Model Number	Average CFM* (L/s)	Motor H.P./kW	Min. Wire Size ++	Dimensions - in/mm			Weight lbs/kg	Tank Capacity (gal/L)
					L	W	H		
88/333	OL11016AC-50	1.0/.472	1/6 / .125	10	32/813	13.5/343	22.5/572	94/43.7	10/38
170/643	OL21533AC-50	2/.944	1/3 / .249	8	32/813	13.5/343	23/584	98/44.5	10/38
268/1015	OL33550AC-50	3.75/1.77	1/2 / .373	6	32/813	13.5/343	23/584	114/51.8	10/38
348/1317	OL435V75AC-50	4.2/1.98	3/4 / .560	6	32/813	14/356	24/610	120/54.5	10/38
488/1847	OL610V100AC-50	5.9/2.78	1 / .746	6	32/813	14/356	24/610	124/56.4	10/38
720/2725	OL900V100AC-50	8.7/4.1	1 / .746	4	35/889	17/432	32/813	165/75	20/76
960/3634	OL1200V200AC-50	11.6/5.47	2 / 1.5	4	35/889	17/432	32/813	165/75	20/76

* Average CFM is the average free air delivery from 0 to 40 PSIG.

++ Based on 100 foot run. Consult Factory for longer or shorter runs.

+ Based on 70 degree F system temp. For other conditions consult factory for pump up times.


**Units 115 or 115 / 230 VAC.
3 Phase Units available - Consult Factory.**

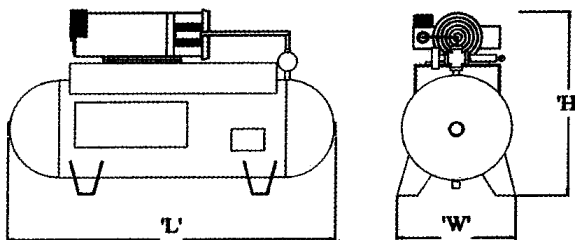

Magnetic Line Starters - Thermal Overload Protection
Single Phase

	115V	230V	Size	Model
Maximum HP	1/3 HP	1 HP	00	MG00A*
	1 HP	2 HP	0	MGX0A*
	2 HP	3 HP	1	MG01A*
	3 HP	5 HP	1P	MG15A*

When Ordering a Magnetic Line Starter you must specify HP, Voltage and Phase that is supplied to the motor.



Air Maintenance Device
Part # AMD-1

The AMD-1 is used when compressed air is supplied through an existing factory air supply or when using tank mounted units.

Call 1-800-345-8207

Fax: 610-524-8965

E-Mail: genairpro@generalairproducts.com


Remember - You can find this sheet and more at

www.GENERALAIRPRODUCTS.com

TANK MOUNTED OIL-LESS COMPRESSORS INSTALLATION INSTRUCTIONS



ALL PIPING AND WIRING TO BE IN ACCORDANCE WITH APPLICABLE STATE, LOCAL AND NATIONAL CODES & SHOULD BE APPROVED BY AHJ

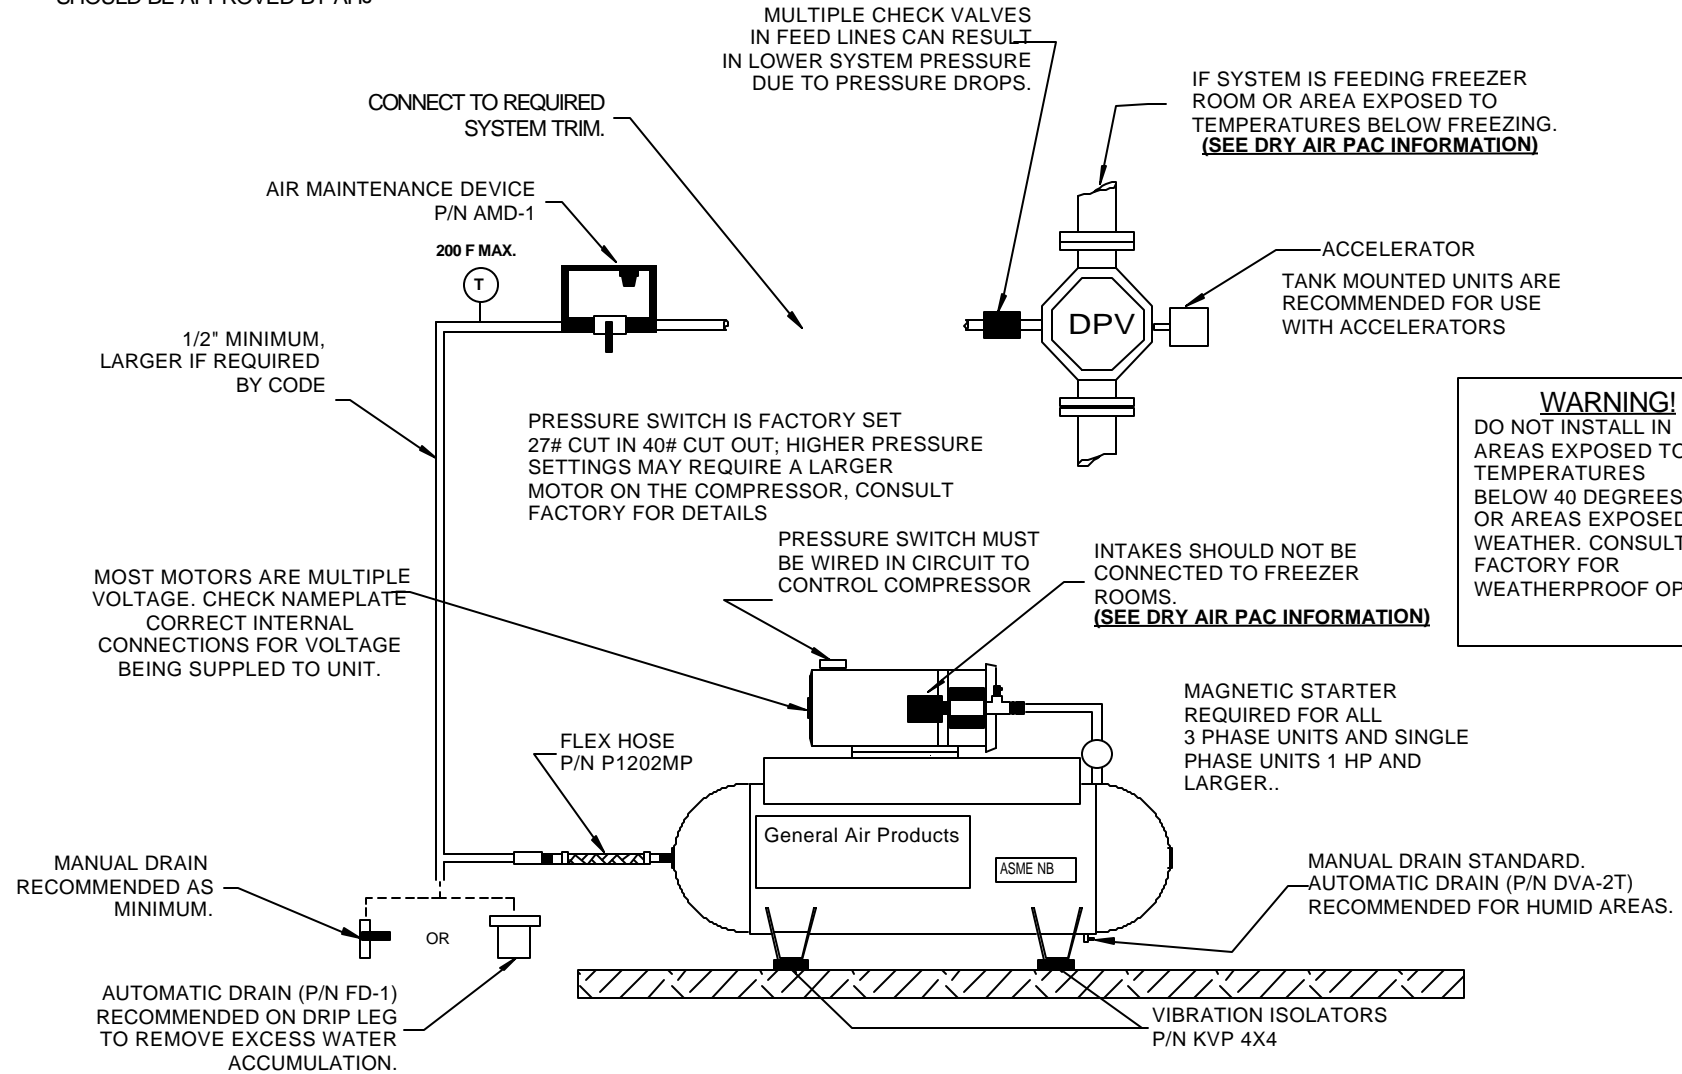

PART NUMBERS LISTED ARE FOR ACCESSORY ITEMS RECOMMENDED FOR COMPLETE INSTALLATION - CONSULT YOUR LOCAL DISTRIBUTOR FOR AVAILABILITY

TNKOLIS (05/03/99)