


800-345-8207 www.generalairproducts.com

Part Number: AMD-2

- 1. Inlet (from Compressor)
- 2. Fill Valve
- 3. Fill Line
- 4. Outlet (to System)
- 5. Maint. Line Ball Valve
- 6. Maint. Line Union
- 7. Y-Strainer
- 8. Unloader Line
- 9. Pressure Switch
- 10. Restrictive Orifice
- Check Valve

Rated at 175 PSI MWP
For Use with L Series Only

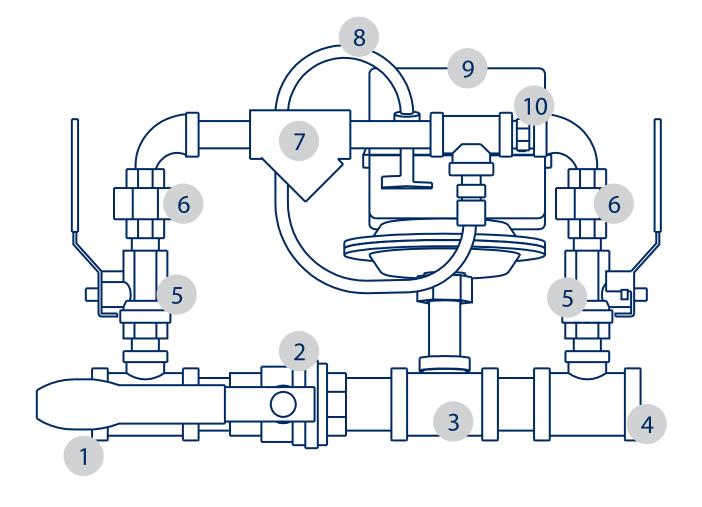

UL Listed / FM Approved Air Maintenance Device