


4

3

2


1

REVISIONS				
ECO	REV	DESCRIPTION	DATE	APPROVED
	2	REDRAWN TO AUTOCAD	09-24-09	
	3	REVISED TANK	08-10-11	
0509	4	ADD 575 VOLTAGE	05-01-20	DPH

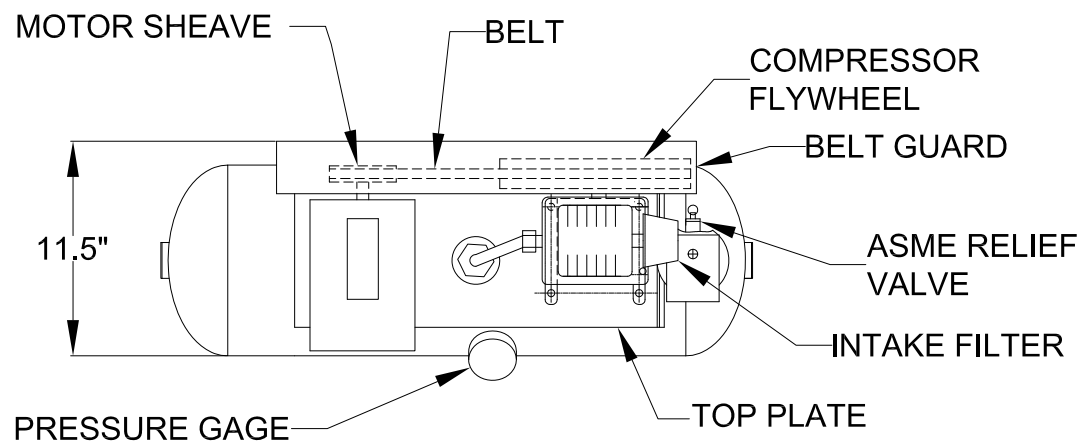


NOTES:


- 1) THIS DRAWING REPRESENTS MULTIPLE ASSEMBLIES. SEE TABLE BELOW FOR MODELS REPRESENTED.
- 2) REFERENCE INDIVIDUAL PARTS LISTS FOR COMPONENT PART NUMBERS.
- 3) REFERENCE INSTRUCTION MANUAL FOR INSTALLATION AND WIRING RECOMMENDATIONS.

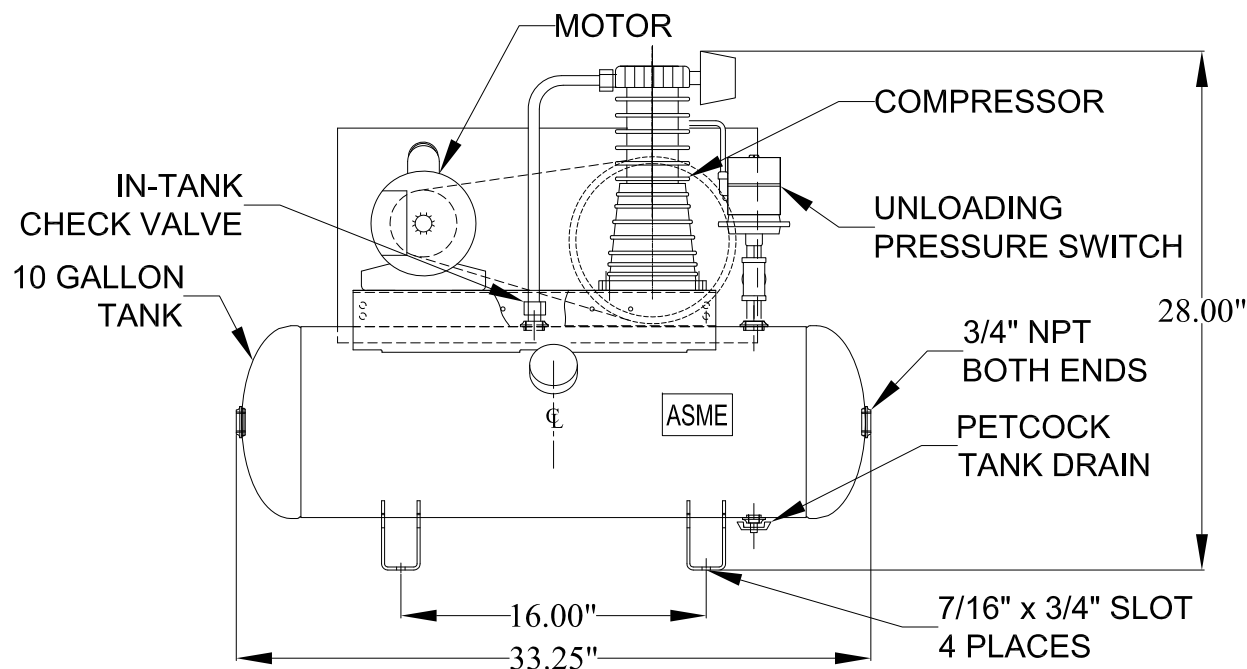

MODEL	VOLTAGE
LT29050A	115/208-230V/60HZ/1PH
LT29050A-50	110/220V/50HZ/1PH
LT29050B	230/460V/60HZ/3PH
LT29050B-50	190/380V/50HZ/3PH
LT29050B-5	575V/60HZ/3PH



COMPRESSORS\LUBRICATED TANK MOUNT\LT-HTZL TANKS\LT-HTZL TANKS GA'S\G-200082 REV 4 GA LT29050

			
APPROVALS	DATE	TITLE	
DRAWN EJR	09-24-09	GENERAL ARRANGEMENT 1/2 HORSEPOWER TANK MOUNTED LUBRICATED COMPRESSOR	
CHECKED DPH	09-24-09		
SCALE NONE	SIZE		
SHEET 1 OF 1	C		
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES ARE: FRACTIONS DECIMALS ANGLES ±1/4 .XX ±.50 ±1/2°		DWG NO.	REV
		G-200082	4

4

3

2

1