

**SINGLE PHASE 80/100 PSI**

**Oil-Less Tank Mount Fire Protection Air Compressors**  
for Dry Pipe & Pre-Action Sprinkler Systems.

**OL Plus Series**



General Air Products newly improved OLT Plus Series Oil Less Tank Mounted Fire Protection Air Compressors are UL 1450, Supplement SC Listed and specifically designed to fill dry pipe and pre-action fire sprinkler systems to Supervisory Pressure within 30 minutes per NFPA 13.



Includes Vibration Pads, 30" Stainless Steel Flex Hose & Union.

*All tank mounted compressors require an Air Maintenance Device to regulate system pressure.*

System Capacity (gal)*	Model Number	Factory Pressure Switch Settings	CFM @10 PSIG	Motor HP	Voltage (volts)	Amperage (amps)		Recommended Wire Size (gauge)			Tank Size	Unit Weight (lbs)
						FLA	Start Up	25' Run	50' Run	100' Run		
120	OLT120-A	45/60**	1.46	1/6	115	3.8	27	12	12	12	10	83
					208-230	2.2	15	12	12	12		
250	OLT250-A	80/100	3.03	1/3	115	4.3	30	12	12	10	10	87
					208-230	2.3	16	12	12	12		
400	OLT400-A	80/100	4.85	1/2	115	9.4	66	12	10	6	10	68
					208-230	4.9	34	12	12	12		
500	OLT500-A	80/100	6.06	3/4	115	9.9	69	12	10	6	10	98
					208-230	5.1	36	12	12	12		
600	OLT600-A	80/100	7.28	1	115	11.3	79	12	10	6	10	98
					208-230	5.7	40	12	12	12		
915	OLT915-A	80/100	11.10	1 1/2	115	16.6	116	12	8	8	20	135
					208-230	8.3	58	10	8	6		
1100	OLT1095-A	80/100	13.34	2	208	11.3	79	10	8	6	20	135
					230	9.6	79	12	12	10		

**Features and Benefits**

- UL 1450, Supplement SC Listed
- CSA C22.2 No.68-Canada
- Oil-Less Piston Compressor
- UL Listed, Pre-Set Pressure Switch
- Fully Automatic, Direct Drive
- ASME Pressure Safety Valve
- Bubble Tight Air Check Valve
- Pre-Wired & Pre-Tested
- Lifetime Technical Support
- Automatic Tank Drain Valve
- Annual Automated Maintenance Reminders
- Includes Vibration Pads, 30" Stainless Steel Flex Hose & Union

\* System Capacity based on 30min fill and at 70°F system temperature.

\*\* Model Number OLT120-A –Optimal On-Off pressure for this unit and must not exceed an On-Off setting of 45/60

**Note:** A listed Air Maintenance Device must be installed in conjunction with all Tank Mounted air compressors.

**Note:** All information is subject to change without notice. Consult factory for most up-to-date product details.

 **WARNING:** Cancer and Reproductive Harm – [www.p65warnings.ca.gov](http://www.p65warnings.ca.gov)


**System Capacity (gal) by System Pressure**

Model Number	@20 PSI	@30 PSI	@40 PSI	@50 PSI	@60 PSI	@70 PSI	@80 PSI	@90 PSI	@100 PSI
OLT120-A	265	170	120	95	75	65	55	45	40
OLT250-A	565	350	250	190	155	125	105	90	75
OLT400-A	930	595	400	325	255	215	180	155	135
OLT500-A	1030	655	500	360	290	240	200	170	145
OLT600-A	1250	790	600	435	350	285	240	210	180
OLT915-A	2190	1325	915	680	525	420	340	280	240
OLT1095-A	2630	1625	1110	860	690	555	465	390	340


The OL Plus Series Fire Protection Air Compressors are UL 1450-VDUR Listed and specifically designed to fill dry pipe and pre-action fire sprinkler systems to supervisory pressure within 30 minutes per NFPA 13.

**OLT Plus Series Tank Mounted Fire Protection Air Compressors**


**MODEL: OLT120-A**

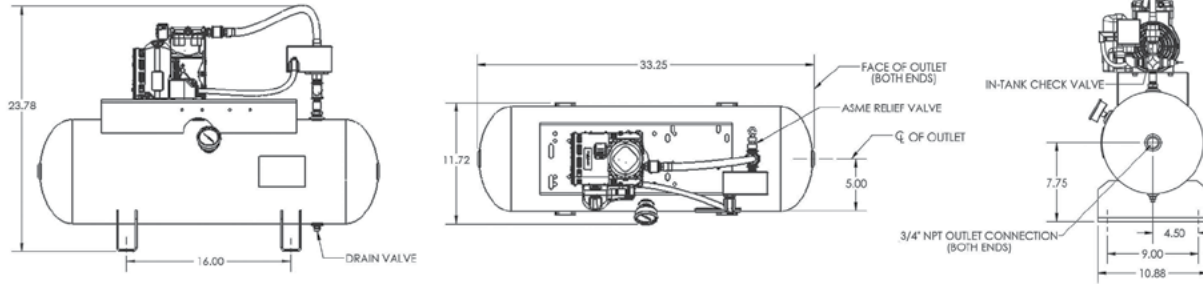


**MODEL: OLT250-A**

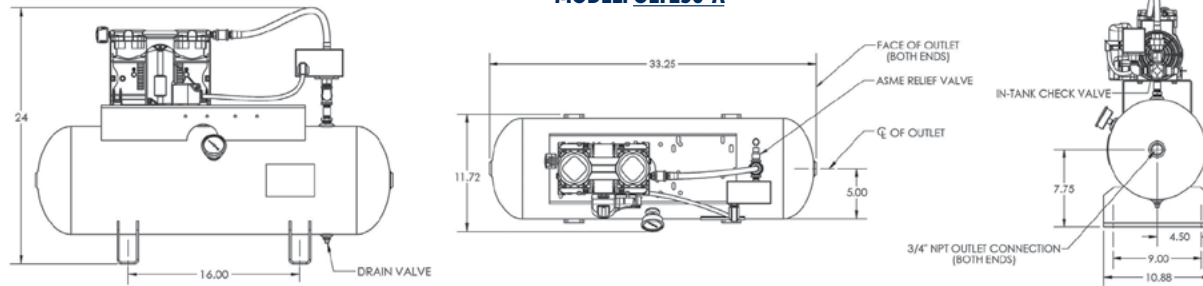

**MODELS: OLT400-A | OLT500-A | OLT600-A**

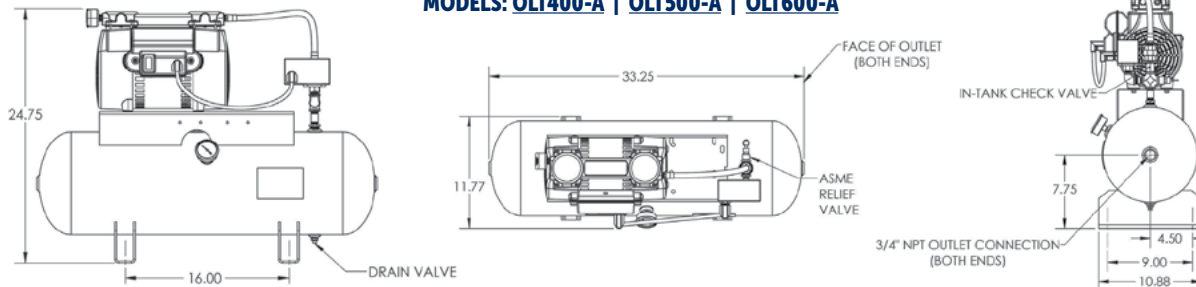

**MODELS: OLT915-A | OLT1095-A**

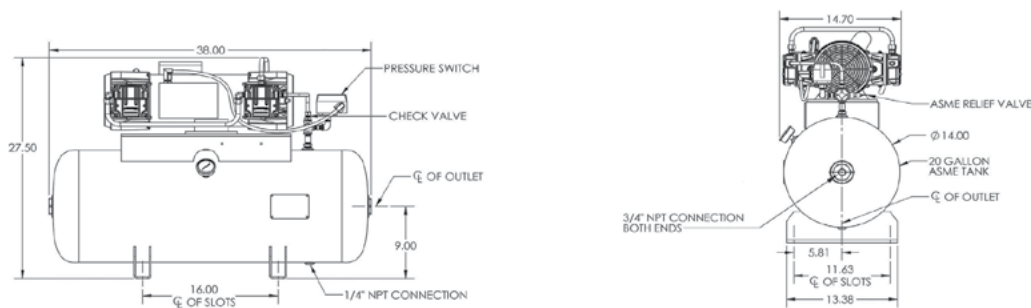

**OLT Plus Series Tank Mounted Fire Protection Air Compressors Accessories**

**VAPOR PIPE SHIELD**

Vapor Pipe Shield is a Patented and UL Listed innovative solution for the prevention of corrosion in Dry-Pipe & Pre-Action Fire Sprinkler Systems.

[LEARN MORE](#)

**AIR MAINTENANCE DEVICE**

The AMD-1 regulates the volume of air being delivered to the sprinkler system by the air compressor.

*Per NFPA 13 - An Air Maintenance Device is required on every dry system unless the air compressor has a capacity less than 5.5 ft<sup>3</sup>/min at 10 PSI.*

Part # AMD-1 [LEARN MORE](#)

**MOTOR LINE STARTER**

**Thermal Overload Protection**

MAX HP	SINGLE PHASE MOTOR LINE STARTERS			Model
	115V	208-230V	Size	
1/3 HP	1 HP	00		MG00A
1 HP	2 HP	0		MGX0A
2 HP	3 HP	1		MG01A
3 HP	5 HP	1P		MG15A

[LEARN MORE](#) *When Ordering a Motor Starter you must specify HP, Voltage & Phase.*