


REVISIONS				
ECO	REV	DESCRIPTION	DATE	APPROVED
0810	0	RELEASE OF DRAWING	12/19/24	TJK

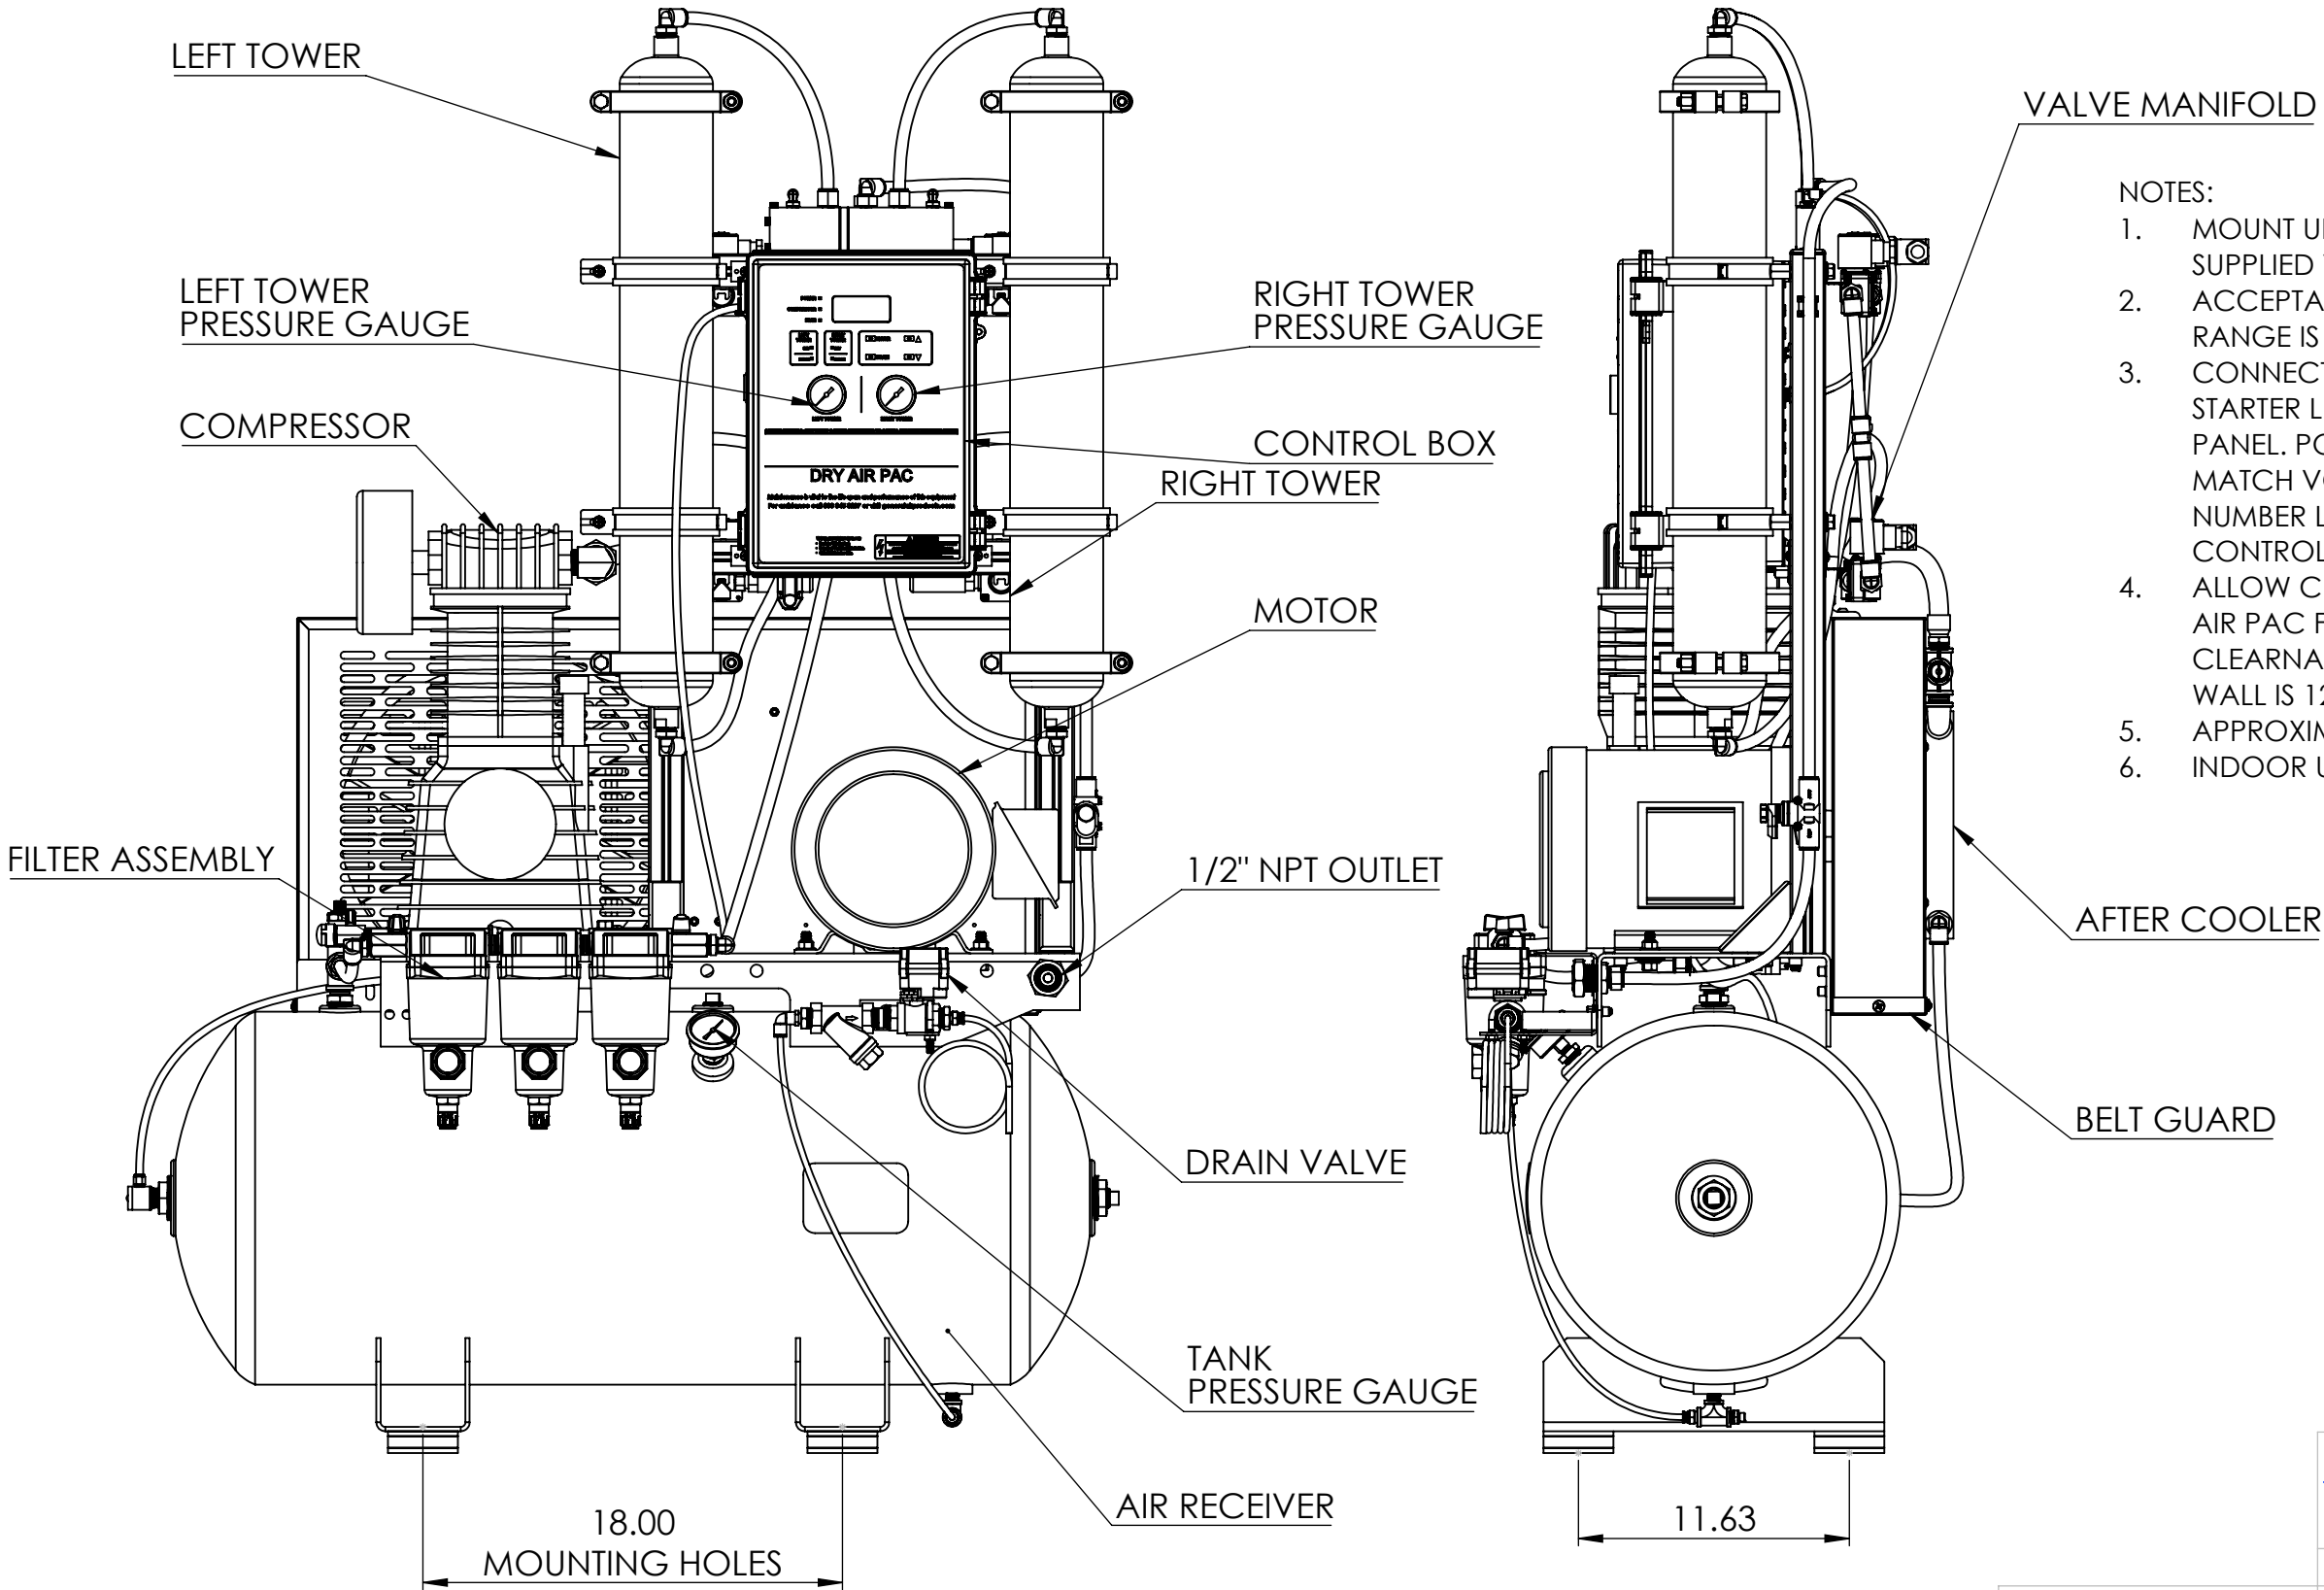

- NOTES:
1. MOUNT UNIT TO A FIRM LEVEL BASE, USING SUPPLIED VIBRATION PAD.
  2. ACCEPTABLE AMBIENT TEMPERATURE RANGE IS 50° F TO 100° F.
  3. CONNECT CORRECT SUPPLY VOLTAGE TO STARTER LINE TERMINALS IN CONTROL PANEL. POWER SUPPLY VOLTAGE MUST MATCH VOLTAGE ON UNITS MODEL/SERIAL NUMBER LABEL ON THE INSIDE OF THE CONTROL PANEL DOOR.
  4. ALLOW CLEARANCE ON ALL SIDES OF DRY AIR PAC FOR MAINTENANCE. MINIMUM CLEARNACE BETWEEN AFTERCOOLER AND WALL IS 12" FOR AIR FLOW.
  5. APPROXIMATE WEIGHT: 375 LBS, SHIPPING: 406 LBS.
  6. INDOOR USE ONLY

N:\Work\Engineering\Drawing File\DAP NEW CANISTERS\DRAWINGS\G-223176 REV 0 GA DAPV 2000

UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE IN INCHES. TOLERANCES ARE:		
FRACTIONS	DECIMALS	ANGLES
±X	.XX±X	±X°

THIS DRAWING AND ALL OF ITS CONTENTS ARE THE SOLE PROPERTY OF GENERAL AIR PRODUCTS, INC. DETAILS MAY CHANGE WITHOUT NOTICE. THE CONTENTS OF THIS DRAWING MAY NOT BE REPRODUCED OR INCORPORATED IN WHOLE OR IN PART IN ANY EQUIPMENT, NOR THE MANUFACTURE OF ANY PARTS, WITHOUT WRITTEN CONSENT OF GENERAL AIR PRODUCTS, INCORPORATED.

		TITLE:	
APPROVALS	DATE	GA DAPV 2000	
DRAWN DL	1/9/2024		
CHECKED TJK	1/9/2024		
SCALE NONE	SIZE		
SHEET 1 OF 1	B	DWG. NO.	REV
		G-223176	0